



中国国家强制性产品认证证书

证书编号：2024010302670334

认证委托人名称及地址

法国溯高美电气公司

1, Rue De Westhouse 67230 Benfeld Cedex France

生产者名称及地址

法国溯高美电气公司

1, Rue De Westhouse 67230 Benfeld Cedex France

生产企业名称及地址

法国溯高美电气公司

1, Rue De Westhouse 67230 Benfeld Cedex France

产品名称和系列、型号、规格

负荷隔离开关

SIRCO PV 1000A, SIROC PV 1250A ;详细参数和接线图请见附页

产品标准和技术要求

GB/T 14048.3-2017

上述产品符合《强制性产品认证实施规则 低压电器 低压元器件》
(CNCA-C03-02:2024)的要求，特发此证。

发证日期：2024年08月05日 有效期至：2029年08月04日

证书信息和有效性可扫描下方二维码或登录发证机构网站查验，
也可在认监委网站 (www.cnca.gov.cn) 查询。



签发：

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司






中国国家强制性产品认证证书

证书编号: 2024010302670334

证书附页: 第 1 页 共 2 页

SIRCO PV 1000A, SIRCO PV 1250A;
额定冲击耐受电压(U_{imp}):12kV;
额定绝缘电压(U_i): 1200V (3P 外形,4P 外形),1500V (6P 外形,8P 外形);
约定发热电流(I_{th}):1000A,1250A;
额定工作电压(U_e):DC 750V (3P 外形),DC 1000V (4P 外形),
DC 1200V (6P 外形),DC 1500V (8P 外形);
额定工作电流(I_e):1000A,1250A;
额定短时耐受电流(I_{cw}):10kA /1s;
额定短路接通能力(I_{cm}):17kA;
使用类别:DC -22B;
极数:3P 外形,4P 外形,6P 外形,8P 外形,见直流接线图;

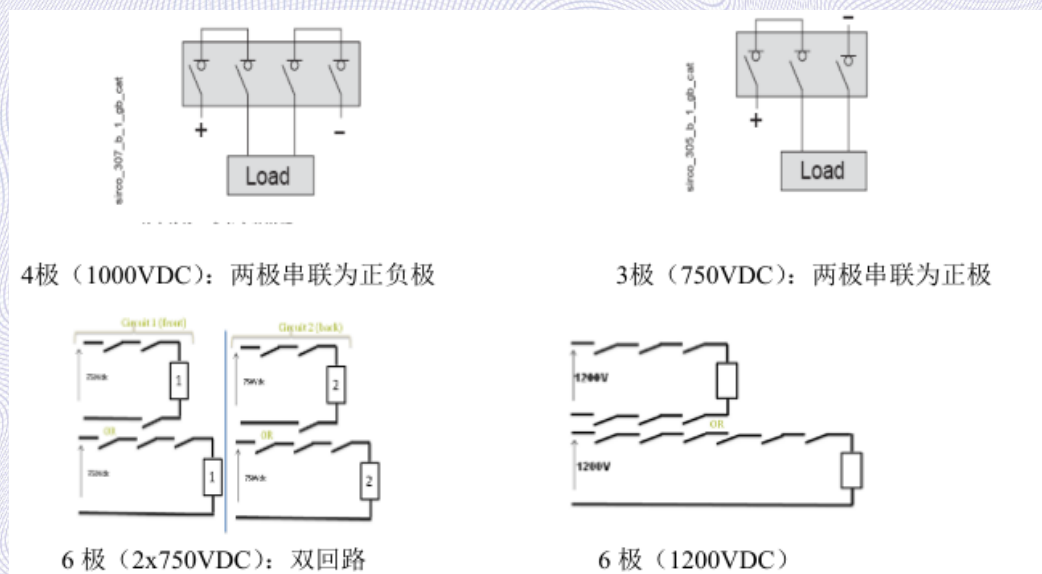

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE


中国质量认证中心有限公司



中国国家强制性产品认证证书

证书编号：2024010302670334

证书附页：第 2 页 共 2 页

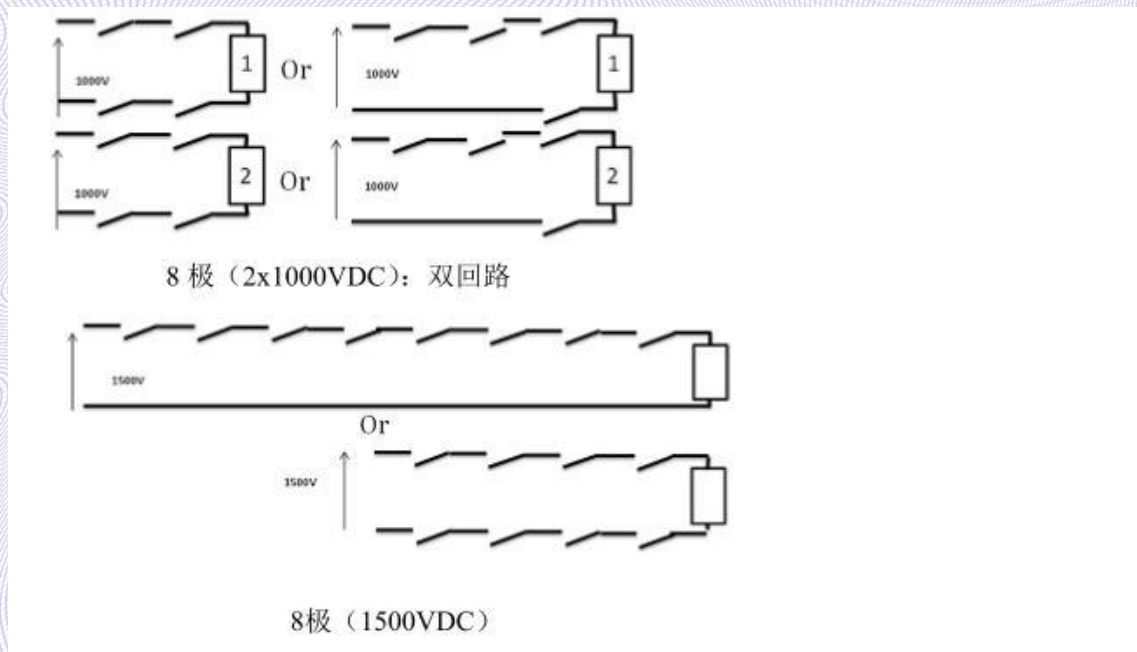

本页为证书附页，应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO.: 2024010302670334

NAME AND ADDRESS OF THE APPLICANT
SOCOMEC S.A.S

1, Rue De Westhouse 67230 Benfeld Cedex France

NAME AND ADDRESS OF THE MANUFACTURER
SOCOMEC S.A.S

1, Rue De Westhouse 67230 Benfeld Cedex France

NAME AND LOCATION OF THE FACTORY
SOCOMEC S.A.S

1, Rue De Westhouse 67230 Benfeld Cedex France

PRODUCT NAME, MODEL AND SPECIFICATION

Load Switch-disconnector

SIRCO PV 1000A , SIROC PV 1250A ,See the Appendix

STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS
GB/T 14048.3-2017

This is to certify that the above mentioned product(s) complies with the requirements of
in implementation rules for compulsory certification (REFNO. CNCA-C03-02:2024).

Valid from : Aug.05,2024

Valid until: Aug.04,2029

The certificate information and validity could be checked by scanning the QR code below or logging in to
the website of the issuing authority, or on the website of the CNCA (www.cnca.gov.cn).



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.






CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO.: 2024010302670334

Appendix: Page 1 of 2

SIRCO PV 1000A, SIRCO PV 1250A ;
U_{imp}:12kV ;
U_i: 1200V (3P appearance, 4P appearance), 1500V (6P appearance, 8P appearance);
I_{th}: 1000A, 1250A ;
U_e: DC 750V (3P appearance), DC 1000V (4P appearance),
DC 1200V (6P appearance), DC 1500V (8P appearance);
I_e: 1000A, 1250A ;
I_{cw}: 10kA /1s;
I_{cm}: 17kA ;
Utilization Category: DC-22B ;
Poles: 3P appearance, 4P appearance, 6P appearance, 8P appearance, See the DC wiring diagram ;

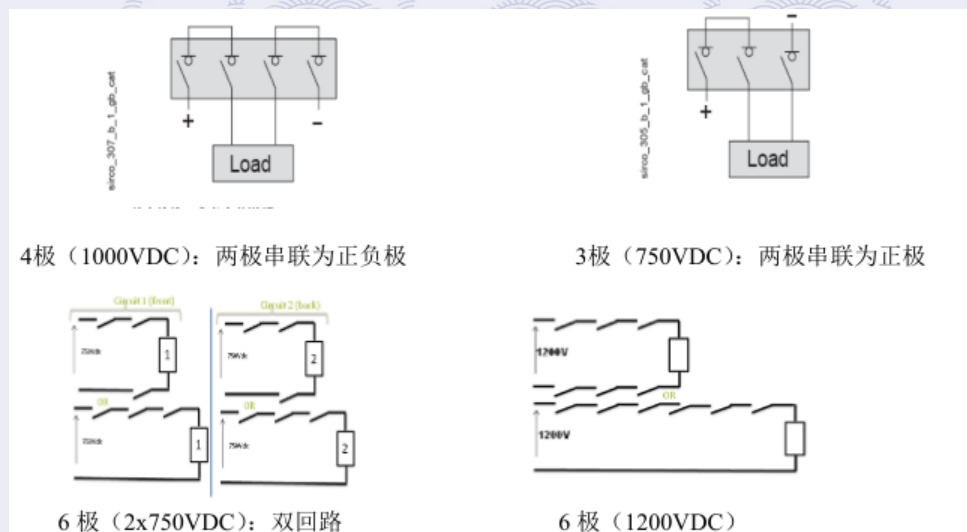

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.




CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION


CERTIFICATE NO.: 2024010302670334

Appendix: Page 2 of 2

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

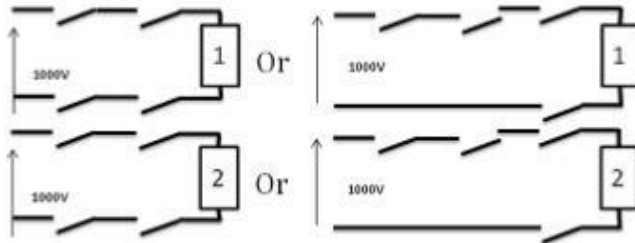

8 极 (2x1000VDC): 双回路

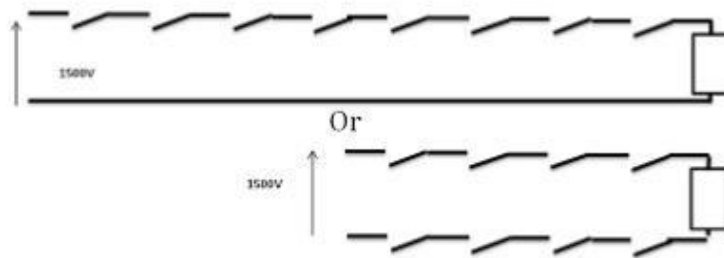

8 极 (1500VDC)

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.